

Tab 4

OVERVIEW

Solar photovoltaic technology is neither new nor experimental. Although the industry has made gradual improvements in the technology over the decades, the materials and technology we use today have changed little in the last 50 years.

“Photovoltaic” is nothing but the technical term for converting the sun’s light into useable electric current, commonly abbreviated as “PV.”

Solar facilities, often referred to as “solar farms,” create a method for passively capturing naturally occurring sunlight and converting it to clean, renewable energy on a scale large enough to supply electricity for homes, businesses, schools and other parts of our daily lives. Each solar farm is a collection of thousands of solar panels placed to capture maximum amounts of sunlight during the day. The panels are linked to “inverters” and “transformers” that convert the sunlight to useable electricity that is transferred to the existing electrical grid.

EQUIPMENT AND CONSTRUCTION

Solar facilities are not complicated, and they include the following basic equipment:

- Solar PV Panels
- Inverters
- Transformers
- Wires and conductor cables
- Structural racking system for PV modules
- Perimeter Fencing

Most sites need no grading, and an entire facility can often be installed with minimal disturbance of the soil. Structural frames (called “racks”) are driven into the ground with steel beams called piles, on which PV panels are mounted. The inverters and transformers are mounted on top of concrete pads where they receive the power produced by the solar panels.

Once complete, sunlight striking the solar panels is converted into low-voltage DC electricity. This low-voltage DC electricity is fed into the inverters where it is converted into low-voltage AC electricity, which is then fed into the transformers where the electricity is converted into medium-voltage AC electricity. The medium-voltage electricity is connected to the grid through underground cables.

NO TOXICITY

The solar PV panels are composed of non-toxic materials, do not erode, and do not have any emissions. Cypress Creek Renewables uses two primary solar PV panel technologies: Crystalline Silicon (C-Si) and Copper-Indium-Selenium (CIS). The solar PV panel is an inert crystal composed of non-toxic materials similar

to a glass plane. The sealed PV panels do not leach metals into the environment and are recycled at the end of their lifecycle.

C-Si modules are produced by sourcing extremely high quality, pure silicon or quartz. The silicon is heated until it melts, after which a crystal is grown from a source ingot. The silicon crystal is sliced into thin wafers and mounted onto a durable backing material, after which the panel is encapsulated by glass and an aluminum frame.

CIS modules work identically to C-Si modules, but use trace elements of different photovoltaic material. The factory heats copper, indium, and selenium and seals them between two sheets of glass and an aluminum frame, eliminating any possibility of leaching into the environment.

Source: Electric Power Research Institute and California Energy Commission. (2003). *Potential health and environmental impacts associated with the manufacture and use of photovoltaic cells*. Sacramento, CA.

AUDIBILITY

Once constructed, the only sound producing component is a cooling fan in the inverter that only operates when the inverter warms up during power production in the middle of the day. The sound created by the inverter during peak power production is typically in the low-range of 65 decibels at a distance of 30 feet, the equivalent of the sound created during normal conversation. At 500 feet from the inverter, sound levels drop to near-inaudible 40 decibels, which cannot be heard over ambient noise in even the quietest rural areas. No sound is produced at night.

The rest of the facility's equipment does not produce significant sound.

Source: Massachusetts Clean Energy Center. (2012). *Study of acoustic and EMF levels from solar photovoltaic projects*. Boston, MA.

GLARE

Solar panels are designed to *absorb* light from the visible spectrum, not to reflect it, although some upward reflection does occur. To assist light absorption, each PV panel is treated with an anti-reflective coating. Naturally occurring ponds and streams, snow, and even certain kinds of soil and vegetation are reflective. The sunlight that is reflected away from solar panels produces the same amount of glare as a flat pond or lake.

Additionally, the solar panels are mounted at an angle that allows for the most light to be absorbed throughout the year, which results in the panels facing the sky at shallow angles (typically less than 25 degrees). As a result, what little light is reflected is not visible to ground-level observers.

All solar farms are required to be approved by the FAA as potential glare hazards for aviators. To date, no PV array has been deemed a glare hazard as is represented by the large numbers of PV power plants built next to highways and around airports.

Source: Riley, E. & Olson, S. (2011). *A study of the hazardous glare potential to aviators from utility-scale flat-plate photovoltaic systems*. ISRN Renewable Energy, 2011. <http://dx.doi.org/10.5402/2011/651857>

ELECTRO-MAGNETIC FIELDS (EMF)

The International Commission on Non-Ionizing Radiation Protection has established 833 milli-Gauss (mG) as the limit for prolonged exposure to electro-magnetic fields. The inverter is the strongest source of magnetic fields in the solar facility with levels varying from 150-500 mG at a distance of one to two feet. As an unmanned facility, prolonged exposure is never an issue. At 150 feet, the inverter's magnetic field levels drop below 0.5 mG or less, often falling to the background level of earth's magnetic field of 0.2 mG.

No other solar PV component emits EMFs that are measureable above the earth's magnetic field. There are no EMFs emitted at night.

Source: Massachusetts Clean Energy Center. (2012). *Study of acoustic and EMF levels from solar photovoltaic projects*. Boston, MA.

SOIL PROTECTION

Minimal ground disturbance only occurs during the short (6 to 12 week) construction period. Heavy equipment and traffic is restricted to perimeter roads, which comprise less than 3% of the site area during construction. To further protect against erosion, most roads on the site are re-seeded with vegetation after construction unless otherwise required by the soil conditions or indicated by the jurisdiction.

A detailed erosion and sedimentation control plan is developed for every project so that water-borne runoff is prevented from entering the surrounding environment. Control measures typically include straw bales, hay coil logs, run-off channels, silt fencing, and sediment basins. Once constructed, natural vegetative growth is encouraged within the facility to prevent erosion, and the areas where panels are located are not considered impervious.

DUST AND WEED CONTROL

During construction, dust levels are kept to a minimum by limiting heavy equipment and traffic to designated perimeter roads and points of site entry. During dry seasons, roads are regularly kept wet to reduce dust. Wet seasons naturally keep dust levels down.

To minimize the encroachment of weeds following construction, CCR employs local arborists to prepare a blend of native grass and shrub seeds for planting across the site. The grounds are watered as needed, and weeds are removed during regular maintenance activities.

Source: National Renewable Energy Laboratory. (2013). *Overview of opportunities for co-location of solar energy technologies and vegetation* (Report No. DE-AC36-08GO28308). Golden, CO.

WILDLIFE PROTECTION

Wildlife is protected by using perimeter fencing and barbed wire to prevent access for large mammals, such as deer. Large animals are kept out of the site because they can interfere with equipment, damage wiring, or injure themselves. In cases when barbed wire is not used, perimeter fence height is increased.

Smaller animals, such as squirrels and birds, are allowed to pass throughout the facility following construction. The environment in the solar facility is often conducive to a wildlife habitat for its natural vegetation as well as providing a significant amount of shade and being relatively undisturbed. Wildlife access to electrical equipment is prevented with conduit protection for wires and sealing all equipment entry points with foam sealant.

Source: Turney, D. & Fthenakis, V. (2011). *Environmental impacts from the installation and operation of large-scale solar power plants*. *Renewable and Sustainable Energy Review*, 15, 3261-3270.

DECOMMISSIONING

Decommissioning and dismantling of the solar PV power plant is not expected to occur until over thirty years after the facility is constructed. The system's equipment, including wires, conductors, and racking, has significant salvage value since it is comprised of useful metals such as copper, aluminum and steel. The PV panels are valuable for their semiconductor materials and rare metals such as silver. The salvage value meets or exceeds the cost of decommissioning. At the end of the facilities' lifetime, a solar reclamation firm will collect the modules for recycling, the inverters for refurbishing, and the hardware for salvage. The land is then reseeded with a local seed mix and can be used for agriculture or other uses.

Source: McGavran Engineering, P.C. (2014) *Solexus development corporation decommissioning proposal*. Charlotte, NC.

MAINTENANCE

Once constructed, solar farms require very little maintenance. As such, there is no need to build travel infrastructure to accommodate traffic. Electrical engineers will service the inverters and transformers on average once per month. Solar PV panels have a very low failure rate (approximately 1 in 10,000 per year), and are easily replaced from inventory stores.

In regions of the United States that are typically dry, such as the Southwest, the panels are cleaned with large cloth dusters approximately once every month. In wetter climates, natural rainfall keeps the panels clean.

Grass is kept under control by mowing and weeds may be spot sprayed if necessary. In some regions, sheep grazing within the facility is used to control vegetation.

Source: National Rural Electric Cooperative Association. (2015). *Cooperative utility PV manual*.

SAFETY

Solar facilities do not generate more than, on average, one to three vehicle visits per quarter, making them insignificant traffic generators that do not create safety issues for the surrounding road networks. By contrast, the national average for single family homes is 9.5 vehicle trips per day.



Additionally, solar PV power plants are constructed according to all required building and electrical codes and safety measures. Site plans are approved by local authorities, and regularly visited throughout construction as required by local ordinance or state building code. Interconnection agreements are carried out as specified by the local utility. Energized system components, such as inverters, are commissioned by the manufacturers' technicians. Solar facilities employ required lock-out measures and safety warnings. A perimeter security fence prevents trespassing and vandalism.

The regular vegetation control methods prevent buildup of debris that could otherwise pose risk of fire material. As such, solar PV facilities pose no increased risk of fires to the surrounding areas.

Sources:

Jeff Court. (2014). *Photovoltaic solar safety management for utilities*. Incident Prevention Magazine, November 2014.

National Fire Prevention Agency. (2015). *National electric code* (pp. 690.1-91, 370.1-120, 376.1-120, 408.1-58, 450.1-48, 480, 490.1-74, 705.1-135, 728, 750). Quincy, MA: National Fire Prevention Agency.

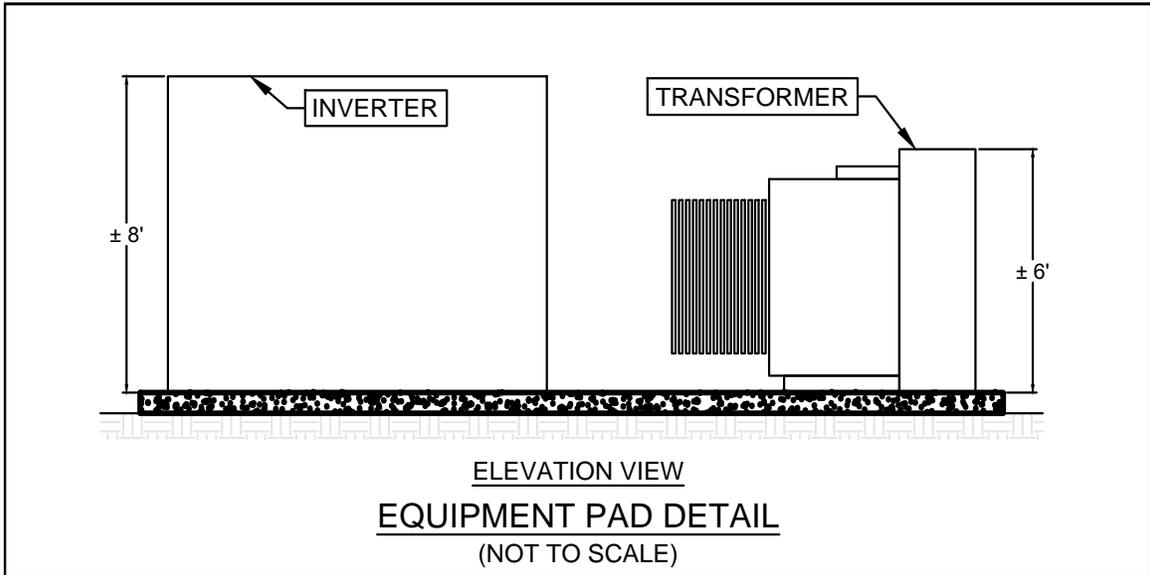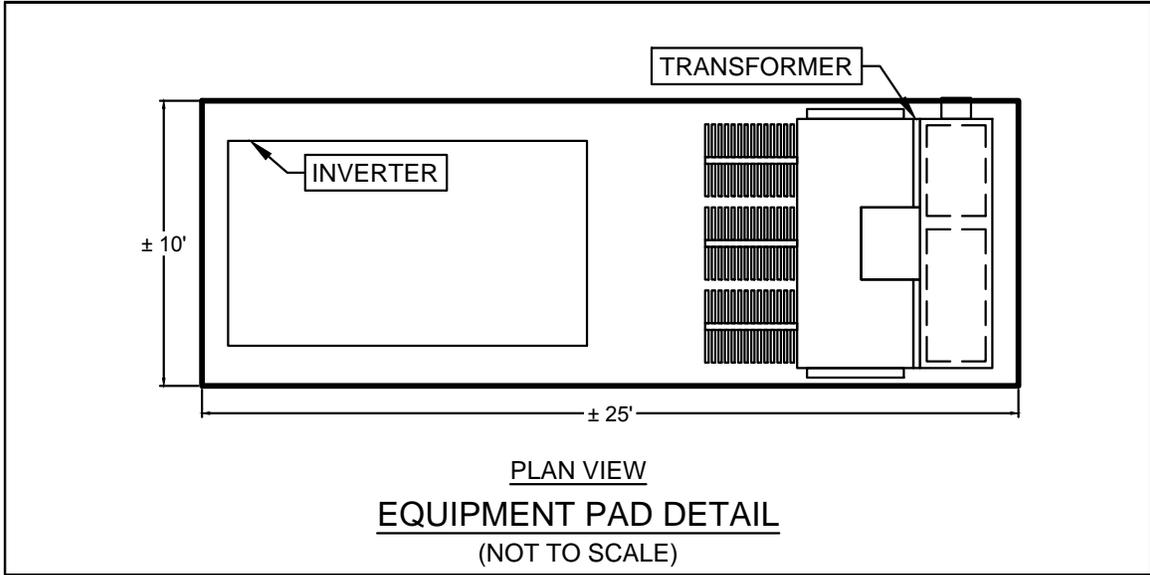



CYPRESS CREEK
RENEWABLES




3250 OCEAN PARK BLVD :: SUITE 355 :: SANTA MONICA, CA 90405
601-A WEST MAIN ST :: CARRBORO, NC 27510

DATE:	XX-XX-XX
DRAWN BY:	XXX
CHECKED BY:	XXX

XXX SOLAR, LLC
POWER STATION
DETAIL

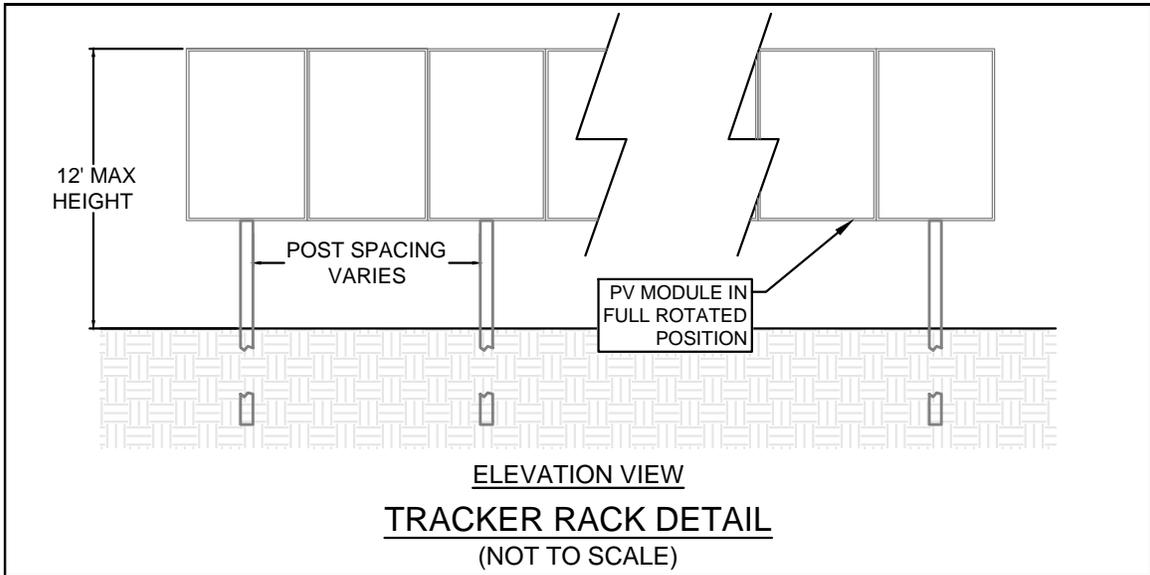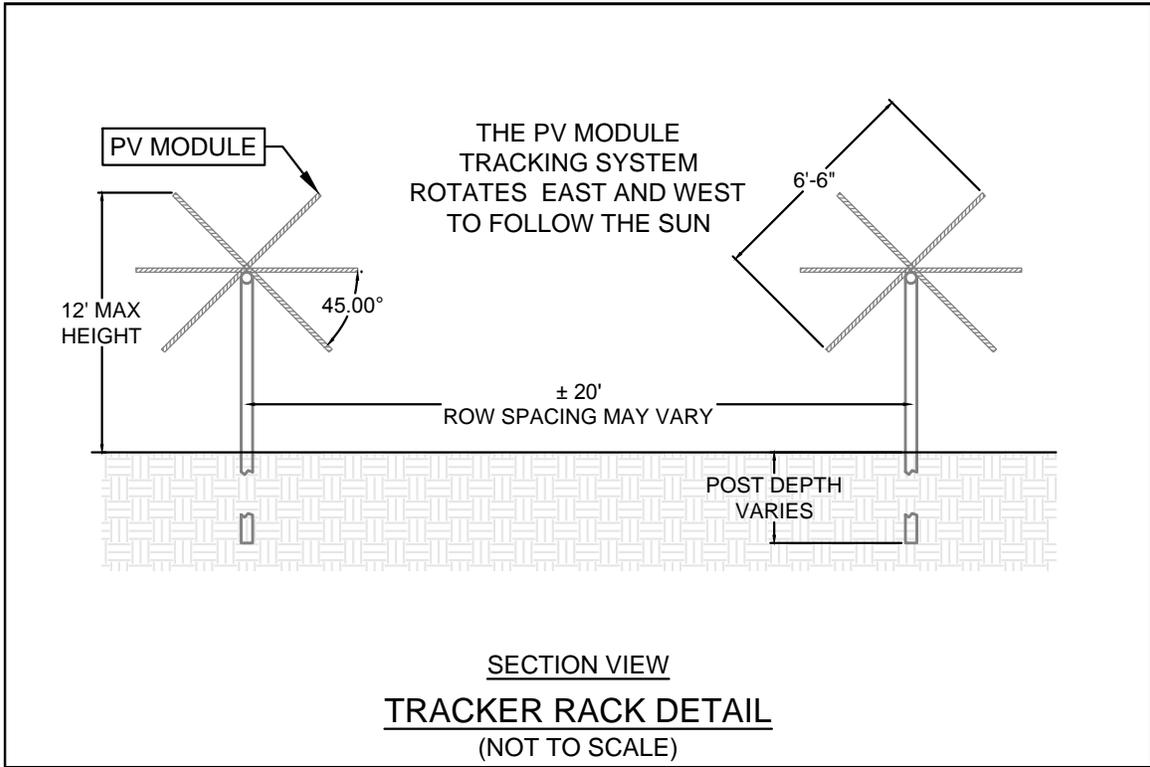



CYPRESS CREEK
RENEWABLES




3250 OCEAN PARK BLVD :: SUITE 355 :: SANTA MONICA, CA 90405
601-A WEST MAIN ST :: CARRBORO, NC 27510

DATE:	XX-XX-XX
DRAWN BY:	XXX
CHECKED BY:	XXX

XXX SOLAR, LLC
TRACKER RACK DETAIL

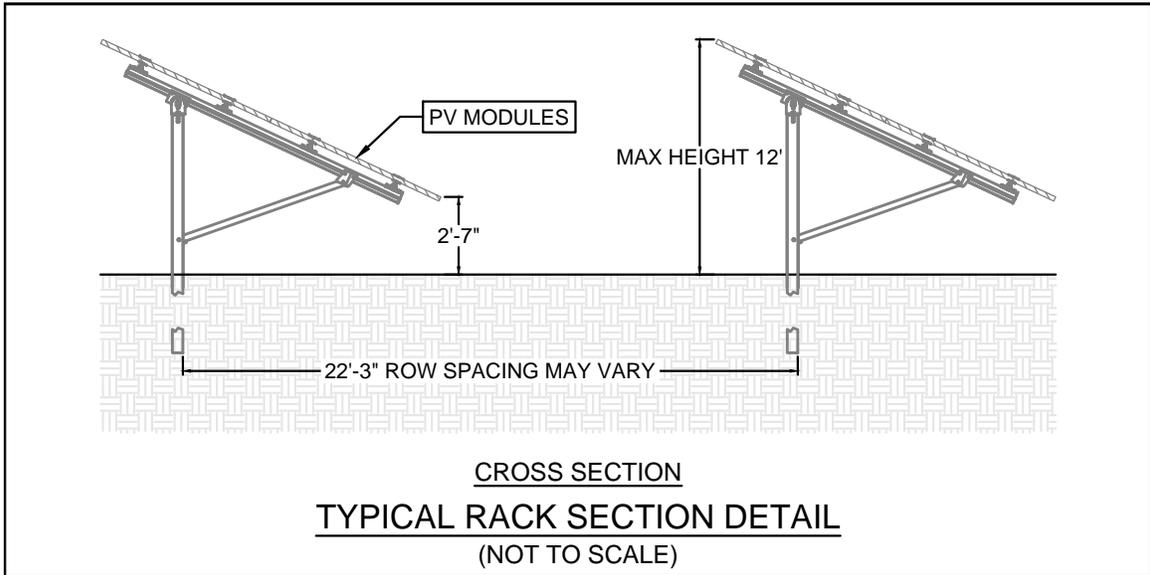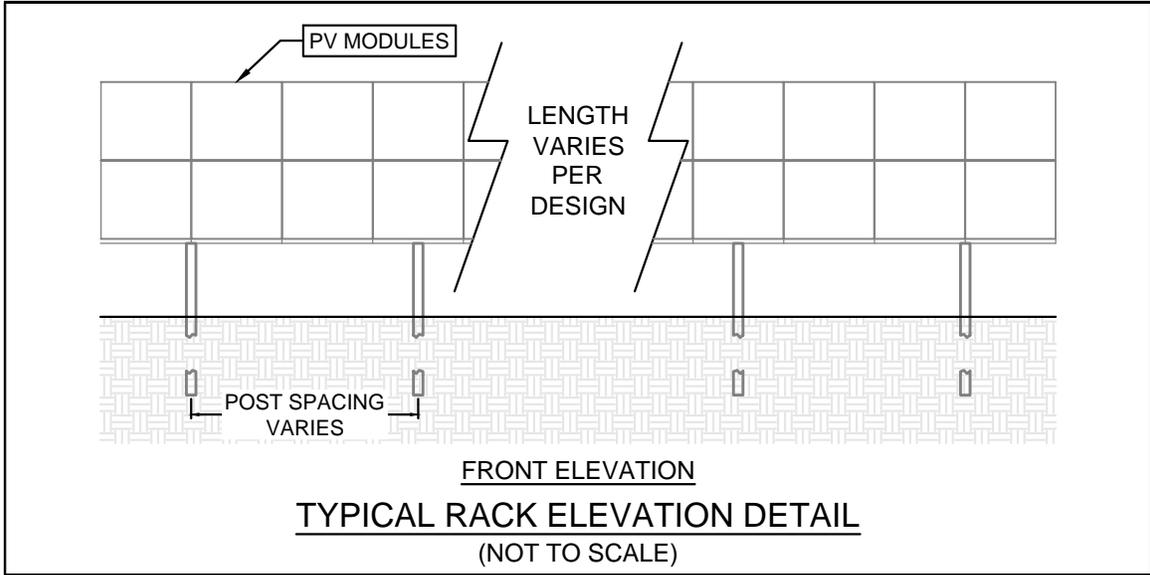

CYPRESS CREEK
 RENEWABLES




3250 OCEAN PARK BLVD :: SUITE 355 :: SANTA MONICA, CA 90405
 601-A WEST MAIN ST :: CARRBORO, NC 27510


DATE:	XX-XX-XX
DRAWN BY:	XXX
CHECKED BY:	XXX

XXX SOLAR, LLC
 FIXED-TILT
 RACK DETAIL

Portage Solar, LLC Fencing 7' no barbed wire

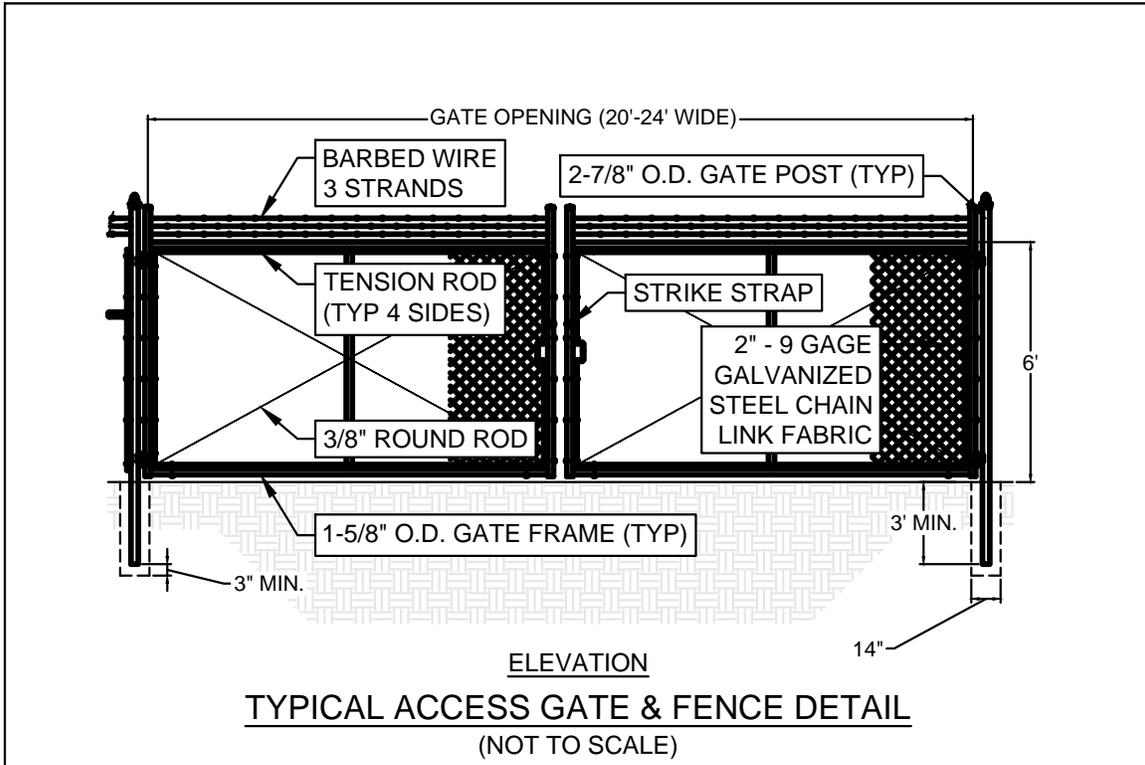

CYPRESS CREEK
 RENEWABLES



3250 OCEAN PARK BLVD :: SUITE 355 :: SANTA MONICA, CA 90405
 601-A WEST MAIN ST :: CARRBORO, NC 27510

DATE:	XX-XX-XX
DRAWN BY:	XXX
CHECKED BY:	XXX

XXX SOLAR, LLC
**SECURITY FENCE
 DETAIL**